SYSTEM UTILITY REQUIREMENTS (INTERMITTENT PEAK USAGE)
ELECTRICAL: 480 VAC / 3 PHASE / 60 Hz / TBD AMPS
STERILE AIR: NA
NON-STERILE AIR: TBD SCFM @ 90 PSIG
STEAM: TBD LBS/HR @ 90 PSIG
POTABLE WATER: TBD GPM
PLANT PROVIDED CAUSTIC: TBD GPM
SANITIZER CHEMICAL: TBD GPM @ 40 PSIG
PROPYLENE GLYCOL: TBD GPM
SPRAY BALL: 60 GPM @ 25 PSI

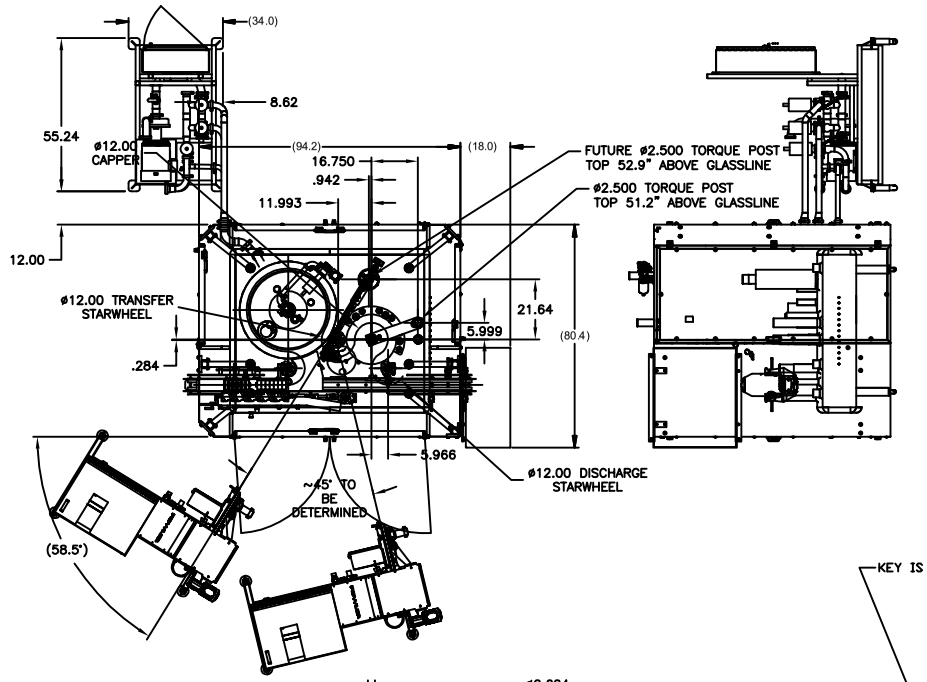

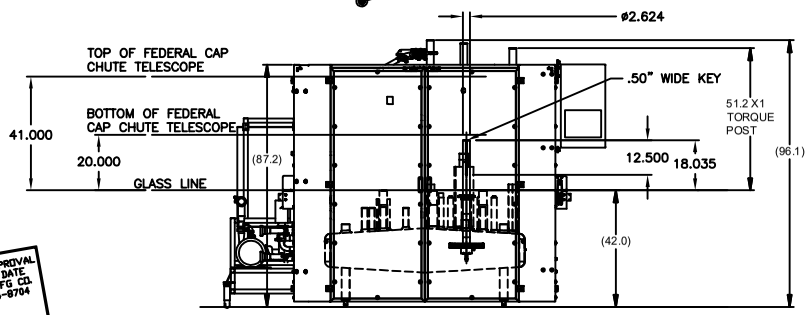

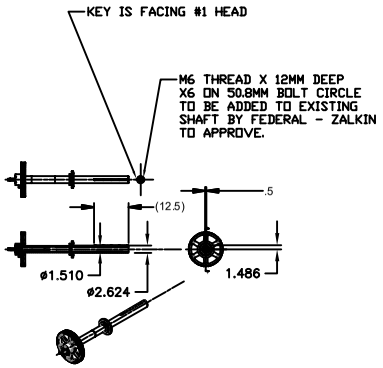

FOR REVIEW AND APPROVAL
PLEASE SIGN AND DATE
FAX TO FEDERAL MFG CO.
FAX NO. (414)-384-8704

REV	DATE	DESCRIPTION

⊕ FEDERAL MFG. CO. MILWAUKEE	SCALE: 1" = 4'	REF:	DWG. NO.	
MACHINE LAYOUT	DWN BY: CAH	APD BY:	L12396-B1	
2/10.4 GR 2417	DATE: 10-23-15	DATE:		